



Element Materials Technology
115 S 84th Avenue
Wausau, WI
54401-8434 USA

P 715 848 3935
F 715 848 0837
T 888 786 7555
info.wausau@element.com
element.com

Summary of Test Results

Product Manufacturer:	Taylor Entrance Systems
Product Type:	Wood Frame Single Inswing Entry Doors
Product Series/Model:	Steel Edge Entry Door 3068
Test Completion Date:	04/18/14
Air Infiltration:	0.02 cfm/ft ²
Water Penetration:	0 psf
Uniform Load Deflection:	±40 psf
Uniform Load Structural:	±60 psf
Purchase Order Number:	T KB 031914 60
Reference must be made to Report No.ESP016471P-1554, dated 05/14/14 for complete test specimen description and detailed test results.	

EAR-CONTROLLED DATA

**LABORATORY TESTING OF WOOD FRAME
STEEL EDGE ENTRY DOOR 3068**

**MANUFACTURED BY
TAYLOR ENTRANCE SYSTEMS**

**Prepared for:
TAYLOR ENTRANCE SYSTEMS
Attn: Mr. Kevin Bulow
631 North First Street
West Branch, MI 48661**

Test Date:


04/16/14, 04/18/14

Prepared By:



Gary Norenberg
Technician
Product Testing Department
Telephone: (715) 848-3935

Reviewed By:



Dan Wadzinski
Technician
Product Testing Department
Telephone: (715) 848-3935

The test results contained in this report pertain only to the specimens tested and not necessarily to all similar products.

It is our policy to retain components and sample remnants for a minimum of 30 days from the report date, after which time they may be discarded. The data herein represents only the item(s) tested. This report shall not be reproduced, except in full, without prior permission of Element Materials Technology.

EAR Controlled Data: This document contains technical data whose export and re-export/retransfer is subject to control by the U.S. Department of Commerce under the Export Administration Act and the Export Administration Regulations. The Department of Commerce's prior written approval may be required for the export or re-export/retransfer of such technical data to any foreign person, foreign entity or foreign organization whether in the United States or abroad.

This project shall be governed exclusively by the General Terms and Conditions of Sale and Performance of Testing Services by Element Materials Technology. In no event shall Element Materials Technology be liable for any consequential, special or indirect loss or any damages above the cost of the work.

EAR-CONTROLLED DATA

INTRODUCTION:

This report presents the results of laboratory testing conducted on a Steel Edge Entry Door manufactured by Taylor Entrance Systems of West Branch, Michigan. This work was requested and authorized by Mr. Kevin Bulow of Taylor Entrance Systems, with testing conducted on April 16 and 18, 2014 at Element Materials Technology facilities. The purpose of the testing was to determine the performance of the door for air infiltration, water resistance and structural integrity.

TEST RESULTS SUMMARY:

The door assembly described herein meets or exceeds the following specifications: ⁽¹⁾ For individual performance levels refer to Element Materials Technology Gateway report ESP016471P-1554.1.

Air Infiltration ASTM: E283: +75 Pa (+1.57 psf) = 0.10 L/s/m² (.02 cfm/ft²)

Water Penetration ASTM: E547: 0 Pa (0 psf)

Uniform Load Deflection ASTM: E330: +1920 Pa (+40 psf) / -1920 Pa (-40 psf)

Structural Load Test ASTM: E330: +2880 Pa (+60 psf) / -2880 Pa (-60 psf)

Forced Entry Resistance AAMA 1304-02: Pass

Vertical Loading Resistance AAMA 925-13: Pass

Operation/Cycling Test AAMA 920-11: Pass

SAMPLE DESCRIPTION:

Unit Size: 953mm (37.50") wide x 2076mm (81.75") high
 Unit Area: 1.98m² (21.29 ft²)
 Panel Size: 908mm (35.75") wide x 2005mm (78.94") high
 Panel Crack Length: 5.04m (16.52')
 Finish: Interior and exterior was steel clad.

Frame Construction: The door frame was constructed of molded finger jointed pine members at the head and sides. The sill was a standard adjustable Endura inswing threshold consisting of extruded aluminum with composite insert and threshold. The frame corners were butted at the head and sill fastened utilizing five 16GA x 11mm (7/16") crown x 51mm (2") long staples per corner. No brickmould was applied.

Panel Construction: The door panel employed a 24ga galvanized steel embossed skin at the interior and exterior snap fit together containing a composite lock block and hinge reinforcement plates. The core of the door was filled with expanded polyurethane foam

<u>Hardware Description:</u>	<u>Quantity</u>	<u>Location</u>
4" x 4" Stainless steel butt hinges	3	Located from the top down 9-5/8", 39-9/16 and", 69-1/2" on center
Schlage dead bolt lock with strike	1	39-5/8" down from top rail on center
Schlage operating handle set with strike	1	45-1/8" down from top rail on center

EAR-CONTROLLED DATA

SAMPLE DESCRIPTION CON'T:

<u>Weatherstrip Description</u>	<u>Quantity</u>	<u>Location</u>
0.500" high Q-Lon QEBD-650 leaf with leg	1 row	Perimeter of door frame
1.750" x 2" Closed cell corner pads	4	Door frame corners
Vinyl Bottom Door Sweep with two hollow bulbs and 5 legs slip fit to a galvanized steel carrier	1	Bottom rail of panel

Installation: The door was installed into a nominal 51mm x 254mm (2" x 10") SPF wood test buck with a shimmed 13mm (1/2") rough opening gap around the entire perimeter. Two #8 x 2-3/4" PFH screws were placed thru each hinge plate and into the buck, and four screws placed thru the lock jamb side and into the buck. The gap between the door frame and test buck was filled in with backer rod and silicone sealant. The gap below the sill was covered with 1/2" x 1-1/2" plywood strip fastened with staples to the buck and sealed with silicone sealant.

TEST RESULTS:

<u>Method</u>		<u>ACTUAL</u>	<u>REQUIREMENTS</u>
<u>E283</u>	<u>Air Infiltration</u>		
	Chamber Pressure, Pa (psf)	+75 (+1.57)	+75 (+1.57)
	L/s/m ² (cfm/ft ²)	0.30 (0.02)	1.5 (.30) maximum
<u>E331</u>	<u>Static Water Penetration</u>		
	Chamber Pressure, Pa (psf)	+0 (0)	0 (0)
	Unpressurized Duration, min.	15.0	15.0
	Cycles	1	1
	Water Penetration	NONE	No water shall flow over the interior face.
<u>E330</u>	<u>Uniform Load Deflection</u>		
	Chamber Pressure, Pa (psf)	+1920 (+40)	----
	Duration, sec.	10.00	10.00
	Top Panel to Lock Span, mm (in.)	991 (39)	----
	Deflection, mm (in.)	0.457 (0.018)	Sustained the load
	Chamber Pressure, Pa (psf)	-1920 (-40)	----
	Duration, sec.	60.00	10.00
	Deflection, mm (in.)	0.279 (0.011)	Sustained the load
	<u>Structural Load Test</u>		
	Chamber Pressure, Pa (psf)	+2880 (+60)	----
Duration, sec.	10.00	10.00	
Permanent Set, mm (in.)	0.178 (0.007)	Sustained the load	
Chamber Pressure, Pa (psf)	-2880 (-60)	----	
Duration, sec.	10.00	10.00	
Permanent Set, mm (in.)	0 (0)	Sustained the load	

EAR-CONTROLLED DATA

TEST RESULTS CON'T:

<u>Method</u>	<u>ACTUAL</u>	<u>REQUIREMENTS</u>
<u>AAMA 1304-02</u>		
<u>Resistance To Forced Entry Test</u>		
Load, kg (lbs.)	135 (300)	135 (300)
Duration, sec.	30.00	30.00
Active Panel	No Entry	No Entry
<u>AAMA 925-13</u>		
<u>Vertical Loading Resistance</u>		
Diagonal Dimension of leaf, mm (in.)	2200 (86.63)	Report
Vertical Deflection after Preload, mm (in.)	1.14 (0.045)	Report
Diagonal Dimension of leaf, mm (in.)	2200 (86.63)	Report
Test Load, N (lbf)	675 (150)	675 (150)
Max Vertical Deflection, mm (in.)	1.83 (0.072)	Report
Permanent Vertical Deflection, mm (in.)	0.381 (0.015)	Report
Diagonal Dimension of leaf, mm (in.)	2200 (86.63)	Report
Forced to latch N (lbf)	27 (6.0)	Reported
Forced to latch Deadbolt	4 (1)	Reported
<u>AAMA 920-11</u>		
<u>Operation/Cycling Test</u> ⁽¹⁾		
Cycles	25,270	25000 Cycles minimum
	Pass	Operable with no permanent deformation

TEST PROCEDURE:

The tests were conducted in accordance with ASTM and AAMA test procedures and the results were compared to the performance requirements.

Air Infiltration

ASTM:E283, Standard Test Methods for Rate of Air Leakage through Exterior Windows, Curtain Walls and Doors

Water Penetration

ASTM:E331, Standard Test Method for Water Penetration of Exterior Windows, Curtain Walls and Doors by Static Air Pressure Difference

Physical Load Testing

ASTM:E330, Standard Test Methods for Structural Performance of Exterior Windows, Curtain Walls and Doors by Uniform Static Air Pressure Differences.

Forced Entry Resistance

AAMA 1304-02: Voluntary Specification for Forced Entry Resistance of Side-Hinged Door Systems

Vertical Loading Resistance

AAMA 925-13: Specification for determining the Vertical Loading Resistance of Side-Hinged Doors



EAR-CONTROLLED DATA**TEST PROCEDURE:****Operation /Cycling Test**

AAMA 920-11: Specification for Operating Cycle Performance of Side-Hinged Exterior Door Systems


REMARKS:

The above results were secured by using the designated test methods and they do indicate compliance with the performance requirements of the referenced specifications. This report does not constitute certification of this product which may only be granted by the Validator.


The representative samples of the tested specimen will be held in the laboratory for a period of four (4) years. Element will maintain this test report and retain test records such as detailed drawings, data sheets or other pertinent project documentation for a period of ten (10) years.

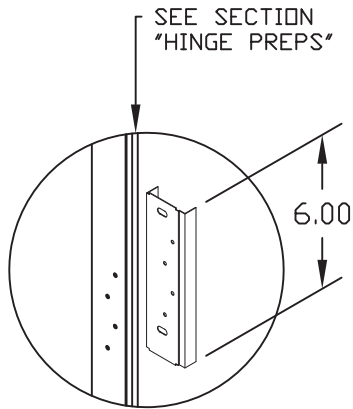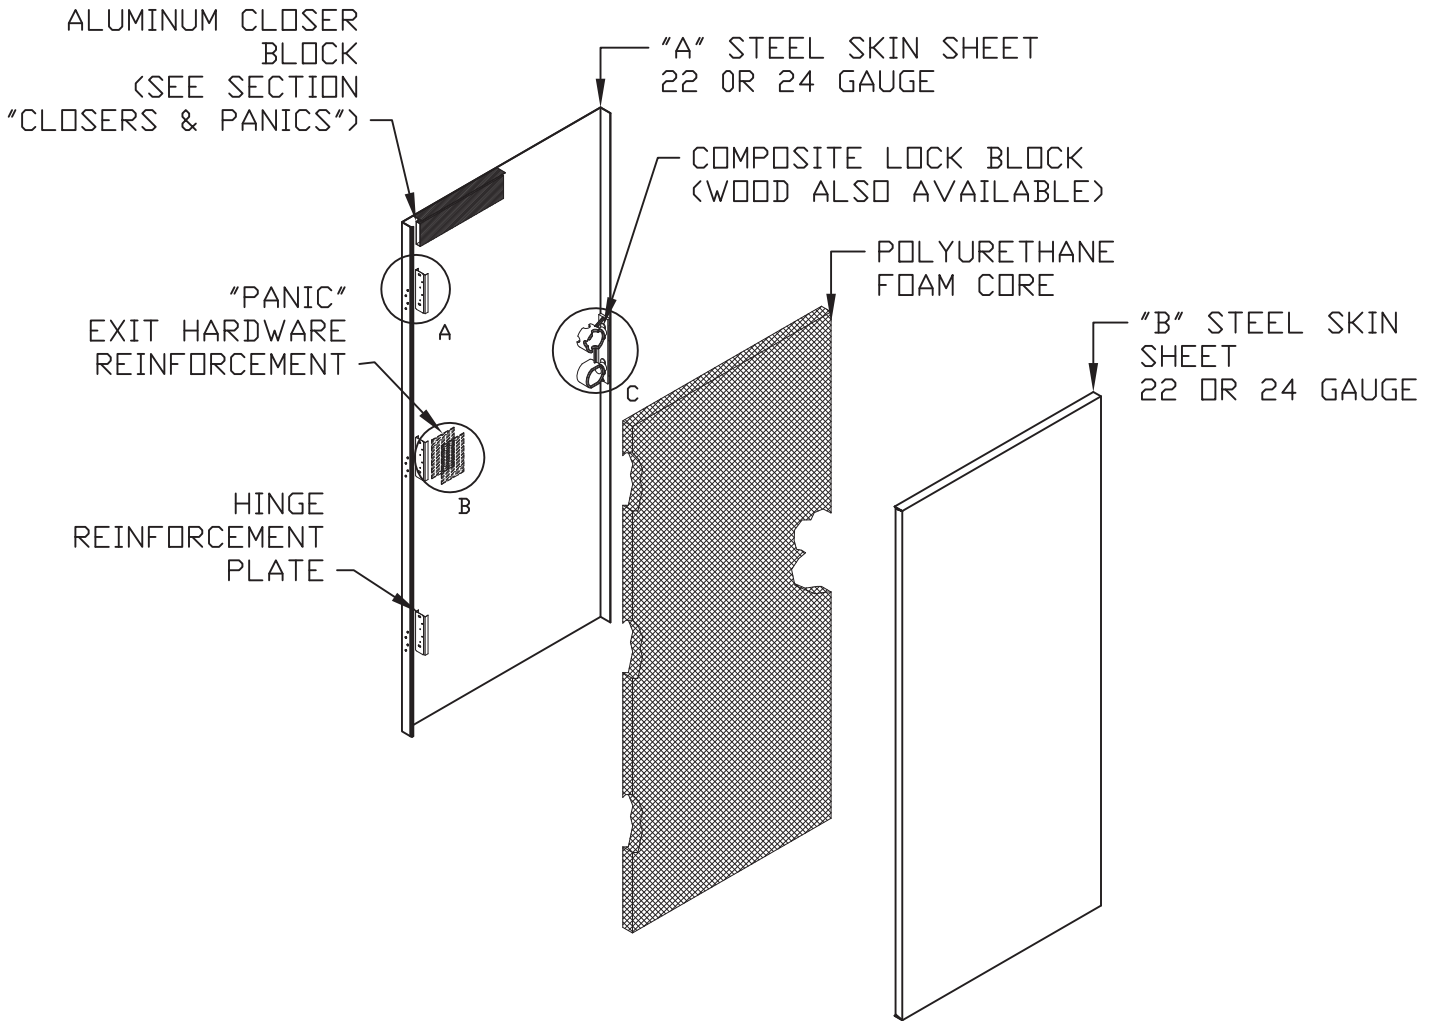

DETAIL "A"
SCALED 4X

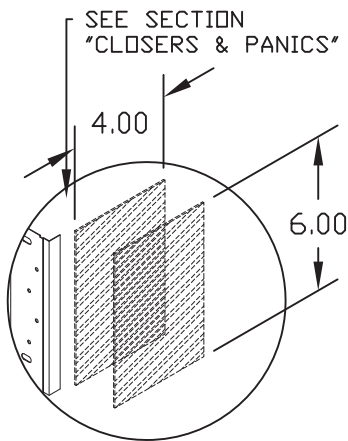

DETAIL "B"
SCALED 4X

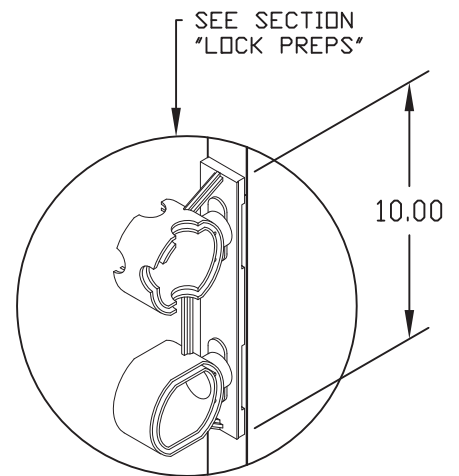

DETAIL "C"
SCALED 4X

NOTE: FOR ILLUSTRATION ONLY



STEEL DOOR
CONSTRUCTION DETAIL

DWG#	II-1
DATE	1-17-05
NAME	MJP
SECTION	II
PAGE	1

CRITICAL DIMENSIONS

+0.03 -0.03 ($+1/32 -1/32$)

DOOR WIDTH	A
2'0"	23.75
2'2"	25.75
2'4"	27.75
2'6"	29.75
2'8"	31.75
2'10"	33.75
3'0"	35.75
3'6"	41.75



DOOR HEIGHT	B	C	D	E	F
6'6"	76.94	9.63	29.94	29.94	45.13
6'8"	78.94	9.63	29.94	29.94	45.13
7'0"	82.94	11.63	29.94	29.94	47.13

NOTE: DOOR TOLERANCES

WIDTH: ± 0.031 " ($\pm 1/32$")


HEIGHT: ± 0.062 " ($\pm 1/16$")

THICKNESS: ± 0.031 " (Nominal $1\ 3/4$ " $\pm 1/32$ ")

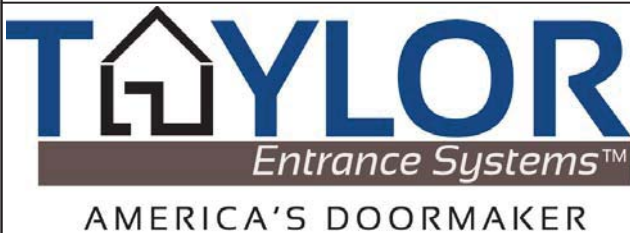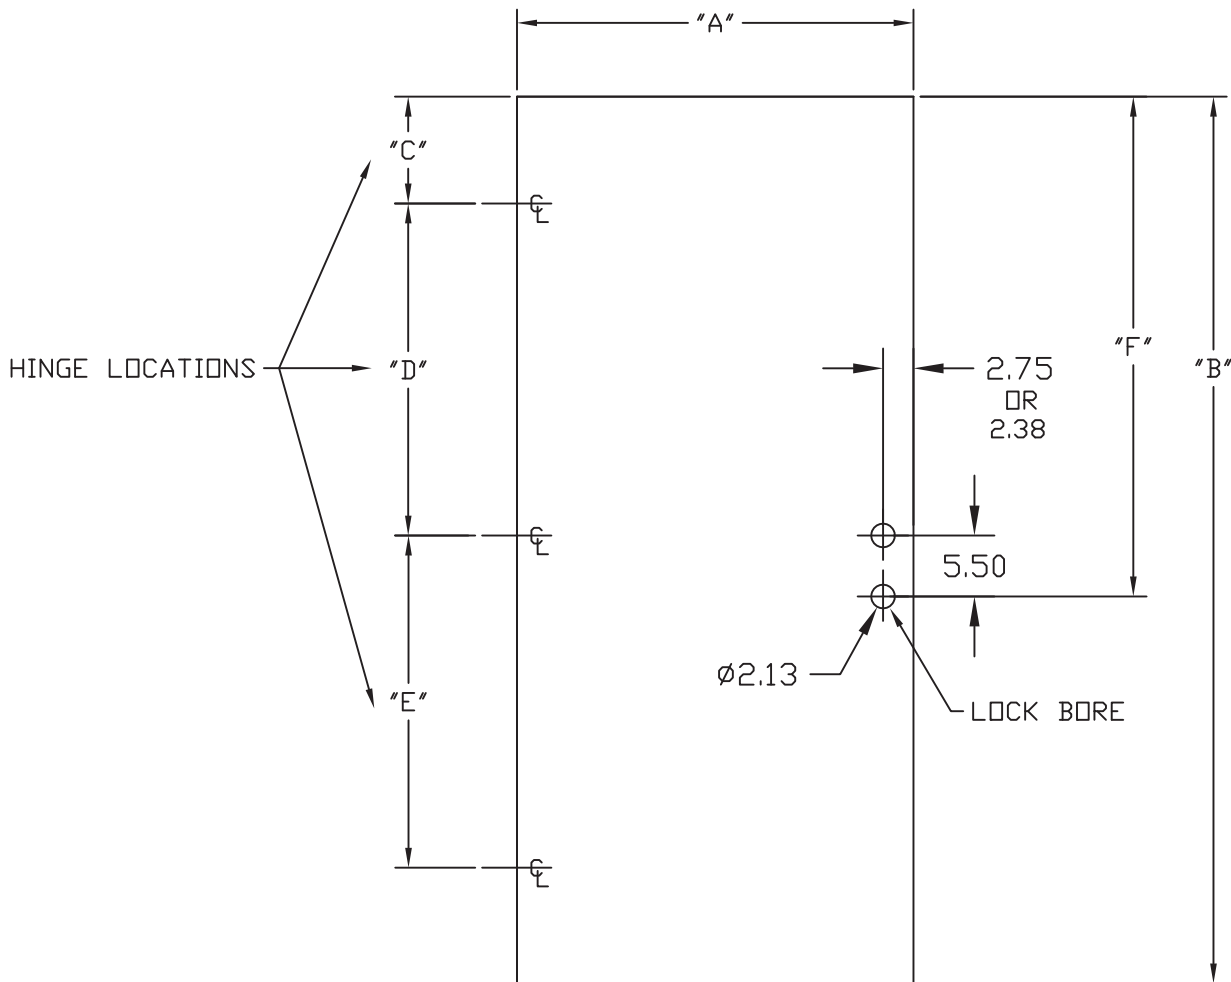

RESIDENTIAL ENTRY DOOR
NEW CONSTRUCTION
STANDARD DIMENSIONS

DWG#	II-2
DATE	6-5-13
NAME	KRB
SECTION	II
PAGE	2

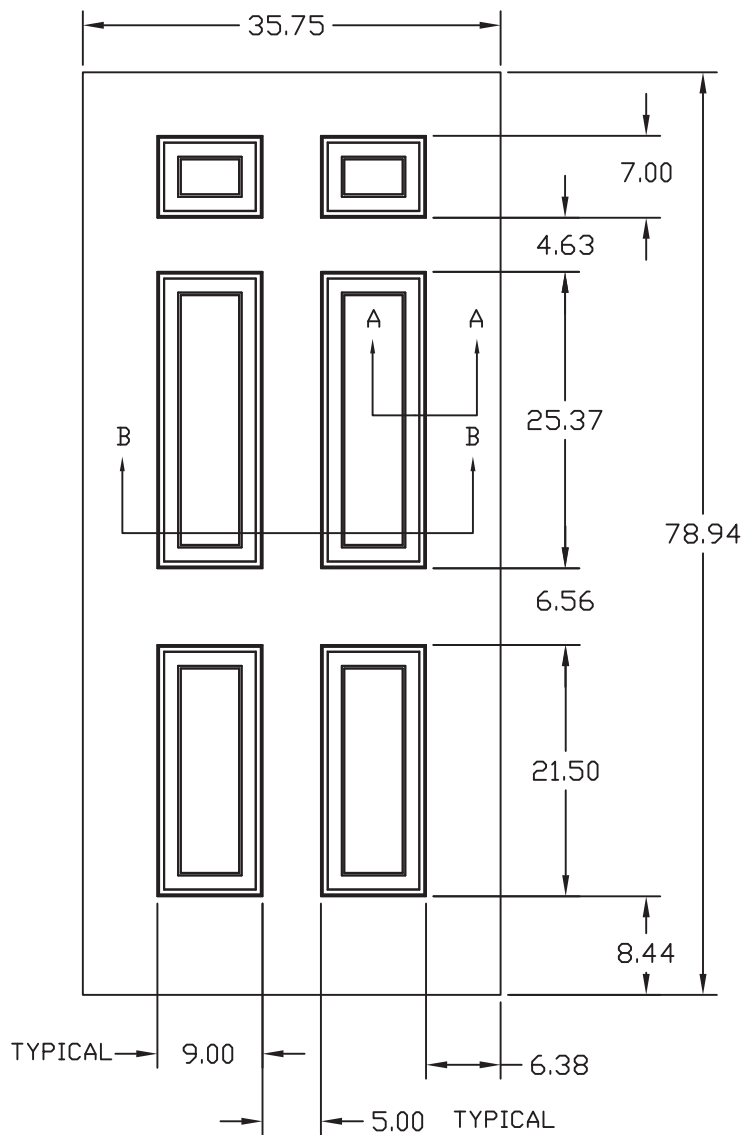


NOTE:
 1/16" TOLERANCE
 ALLOWED FROM CENTERLINE
 FOR EMBOSSEMENT LOCATIONS
 TOP TO BOTTOM
 AND SIDE TO SIDE.

NOTE:
 THIS LAYOUT BASED ON:
 3'0" X 6'8" EMBOSSED DOOR
 FOR 7'0
 EMBOSSEMENT LOCATION
 DIFFERENCE IS SPLIT BETWEEN
 TOP AND BOTTOM RAILS


EMBOSSMENT PROFILE
SECTION A-A

SCALE 16X

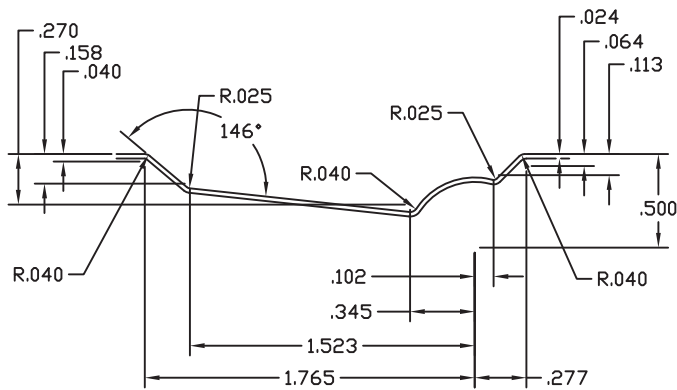

EMBOSSMENT
SECTION B-B

SCALE 2X
 ALL DIMENSIONS (T.S.C.) TO SHARP CORNER

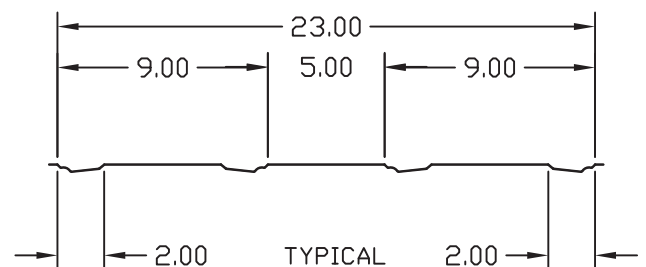

TAYLOR 6 PANEL EMBOSSEMENT
 OPTION FOR STEEL DOORS
 AVAILABLE IN STAINABLE STEEL

DWG#	II-12
DATE	1-18-05
NAME	MJP
SECTION	II
PAGE	12